

**Novel Milbradt Solar LLC  
Solar PV Project – 1.0 MW AC  
Redwood County, Minnesota**

**POWER SYSTEM AND ARC FLASH HAZARD ANALYSIS REPORT**

**Rev.0**

## Certification

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly licensed professional ENGINEER under the laws of the state of Minnesota.




DURAK EVRIM ERCAN, P.E.  
Registration No. 57332 Date: 02/13/2022


Report Revision Notes		
Rev No.	Issue Date	Description
0	02/13/2022	Issued for Review and Approval.

## TABLE OF CONTENTS


<b>SECTION 1 - INTRODUCTION.....</b>	<b>3</b>
1.1 SCOPE AND DESCRIPTION.....	3
1.2 LIMITATION OF LIABILITY.....	4
<b>SECTION 2 - SYSTEM MODELING AND INPUT DATA .....</b>	<b>5</b>
2.1 INPUT DATA COLLECTION.....	5
2.2 UTILITY COMPANY DATA.....	5
2.3 STUDY ONE-LINE DIAGRAM .....	6
2.4 FEEDER INPUT DATA.....	9
2.5 TRANSFORMER INPUT DATA .....	10
<b>SECTION 3 - ENGINEERING ANALYSIS.....</b>	<b>11</b>
3.1 MODES OF OPERATION AND SCENARIOS .....	11
3.2 ASSUMPTIONS AND CLARIFICATIONS.....	11
<b>SECTION 4 - SHORT CIRCUIT STUDY.....</b>	<b>12</b>
4.1 LINE TO LINE DC MOMENTARY FAULT CURRENT RESULTS.....	15
4.2 THREE-PHASE AC MOMENTARY FAULT CURRENT RESULTS .....	17
4.3 LINE TO LINE DC INTERRUPTING FAULT CURRENT RESULTS .....	20
4.4 THREE-PHASE AC INTERRUPTING FAULT CURRENT RESULTS .....	21
4.5 LINE TO GROUND DC MOMENTARY FAULT CURRENT RESULT.....	22
4.6 SINGLE-LINE TO GROUND AC MOMENTARY FAULT CURRENT RESULT .....	24
4.7 LINE TO GROUND DC INTERRUPTING FAULT CURRENT RESULTS .....	27
4.8 SINGLE-LINE TO GROUND AC INTERRUPTING FAULT CURRENT RESULTS.....	28
<b>SECTION 5 - EQUIPMENT AND DEVICE EVALUATION STUDY .....</b>	<b>29</b>
5.1 THREE-PHASE TO GROUND FAULT EQUIPMENT DUTY RESULTS .....	30
5.2 SINGLE-LINE TO GROUND FAULT EQUIPMENT DUTY RESULTS .....	31
<b>SECTION 6 - PROTECTIVE DEVICE COORDINATION STUDY .....</b>	<b>32</b>
6.1 TIME-CURRENT COORDINATION CURVES (TCC).....	34
6.2 PROTECTIVE DEVICE SETTING SOLID STATE CIRCUIT BREAKERS.....	38
6.3 PROTECTIVE DEVICE SETTINGS – THERMAL MAGNETIC CIRCUIT BREAKERS.....	39
6.4 PROTECTIVE DEVICE SETTINGS – SOLID STATE RELAYS.....	40
6.5 PROTECTIVE DEVICE SETTINGS - FUSES .....	41
<b>SECTION 7 - ARC FLASH HAZARD ANALYSIS .....</b>	<b>42</b>
7.1 DC ARC FLASH RESULTS .....	47
7.2 AC ARC FLASH RESULTS .....	49
7.3 ARC FLASH LABELING PROCEDURES.....	51
7.4 SAMPLE ARC FLASH LABELS .....	52
<b>SECTION 8 - RECOMMENDATIONS.....</b>	<b>53</b>

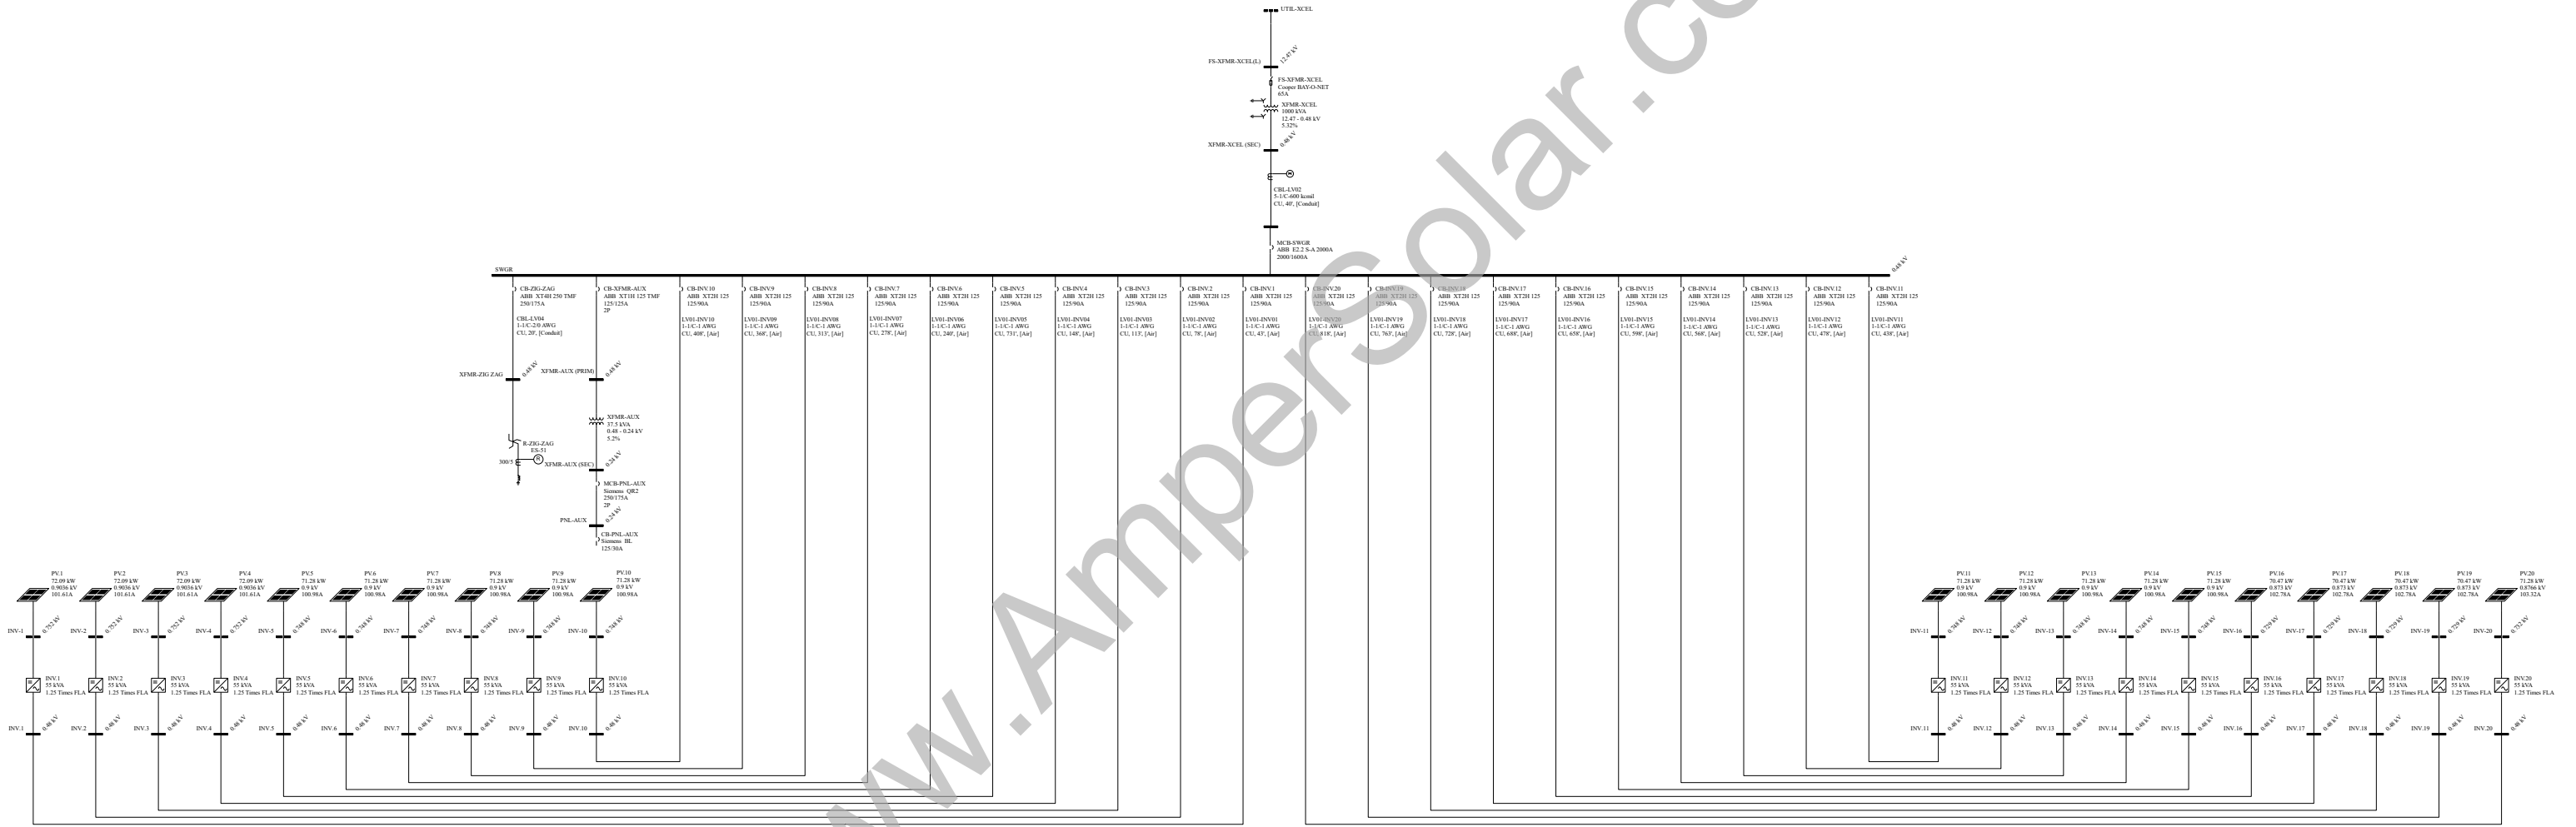

CURRENT IN AMPERES X 100 AT 480 VOLTS

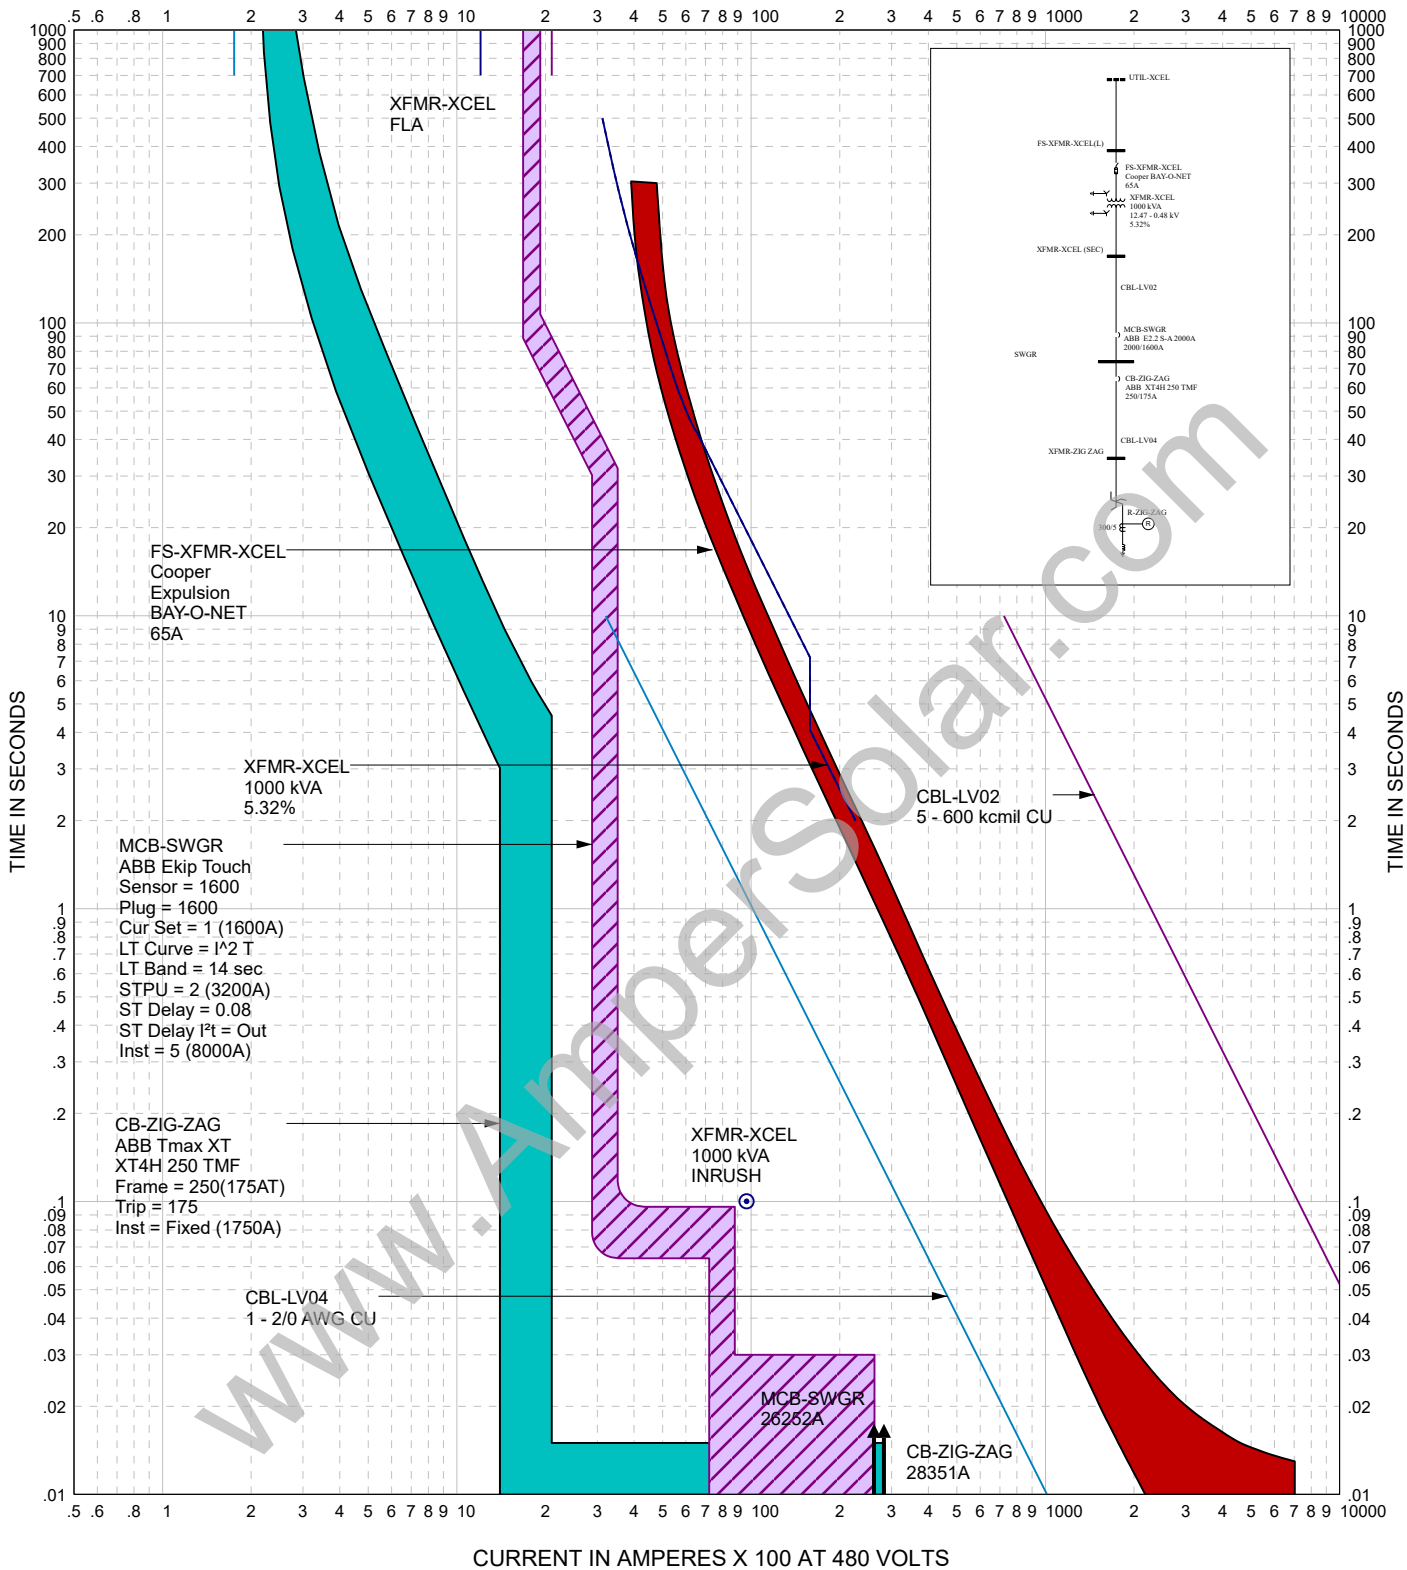

CURRENT IN AMPERES X 100 AT 480 VOLTS

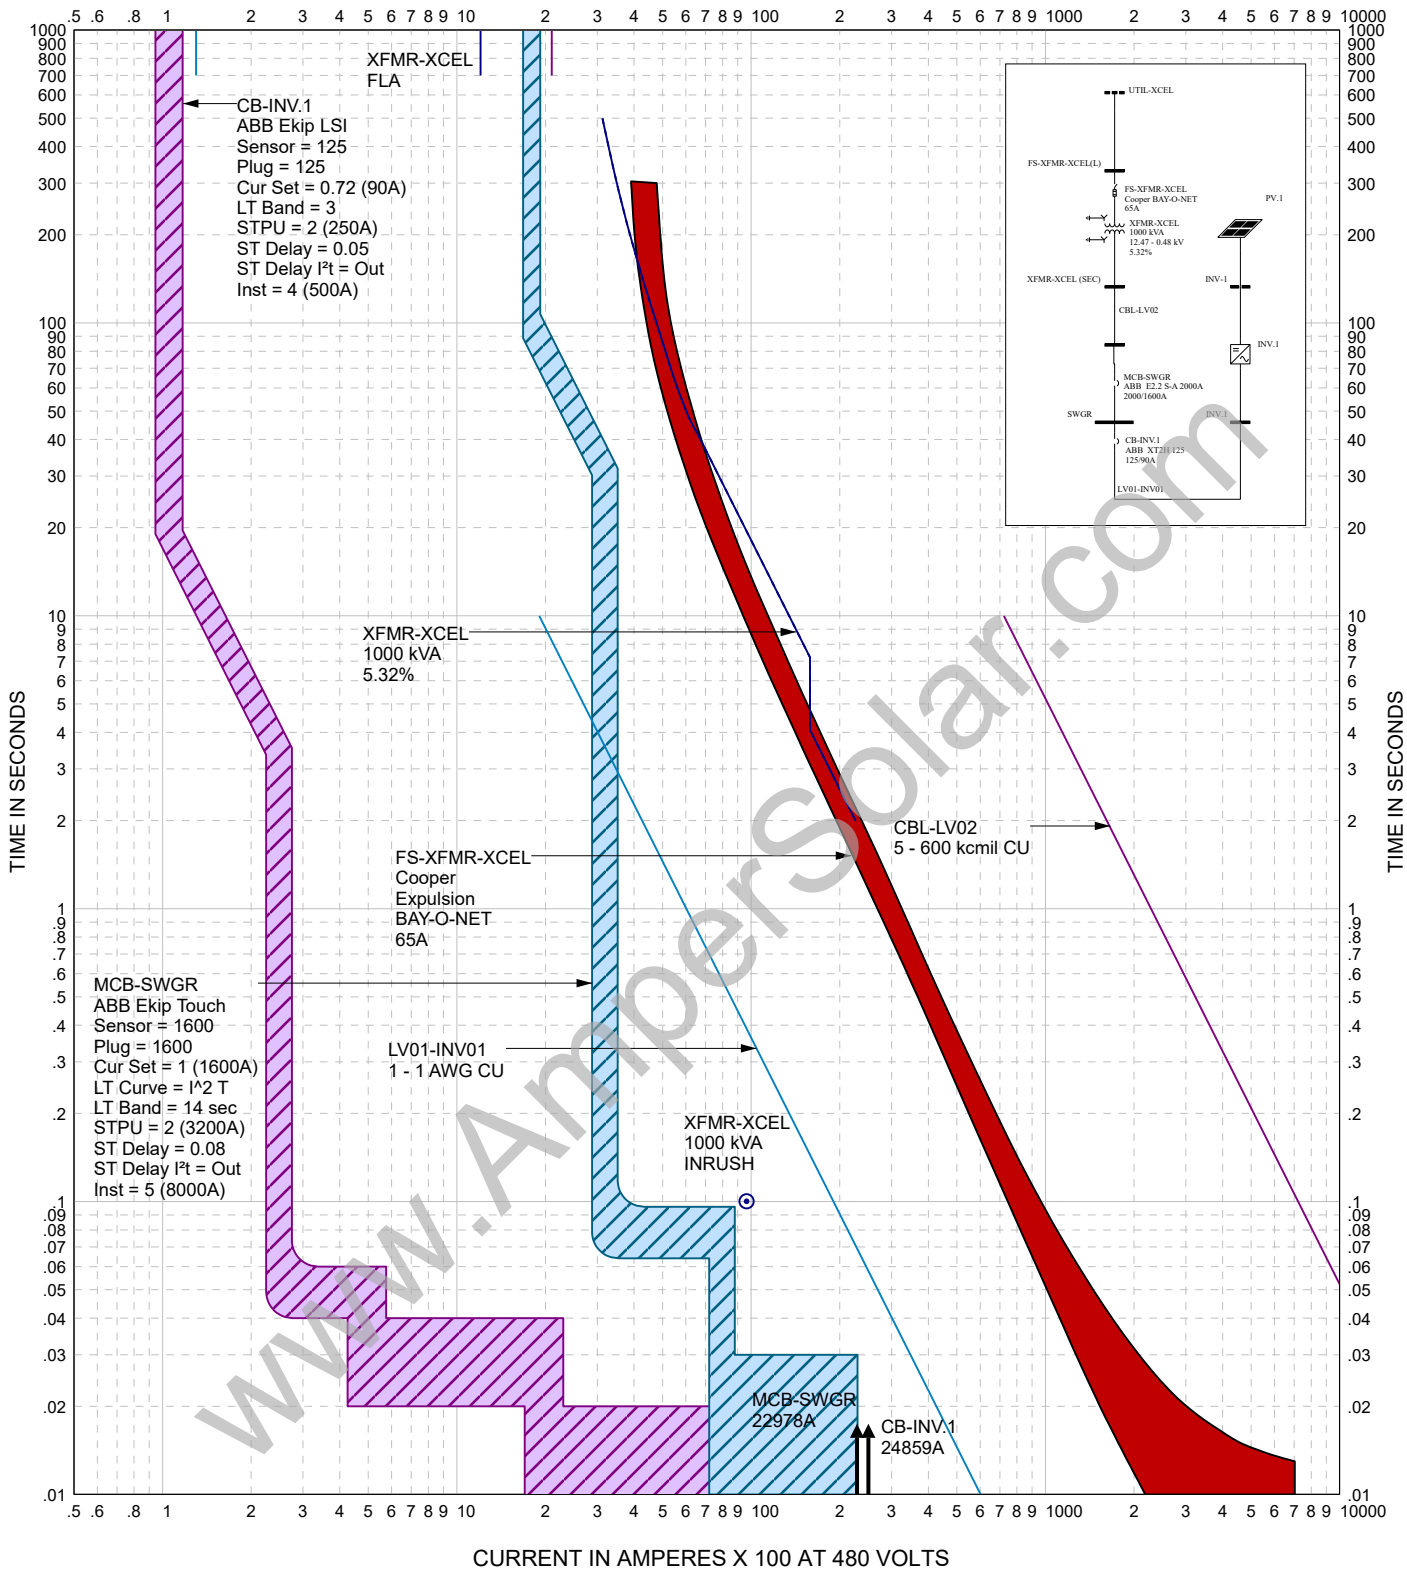


**EasyPower<sup>®</sup>**  
**TIME-CURRENT CURVES**

TCC-2

Recommended settings show best possible coordination

FAULT: 3 Phase  
 DATE: 13/02/2022  
 BY: D. Evrim Ercan, P.E.  
 REVISION: 0

CURRENT IN AMPERES X 100 AT 480 VOLTS

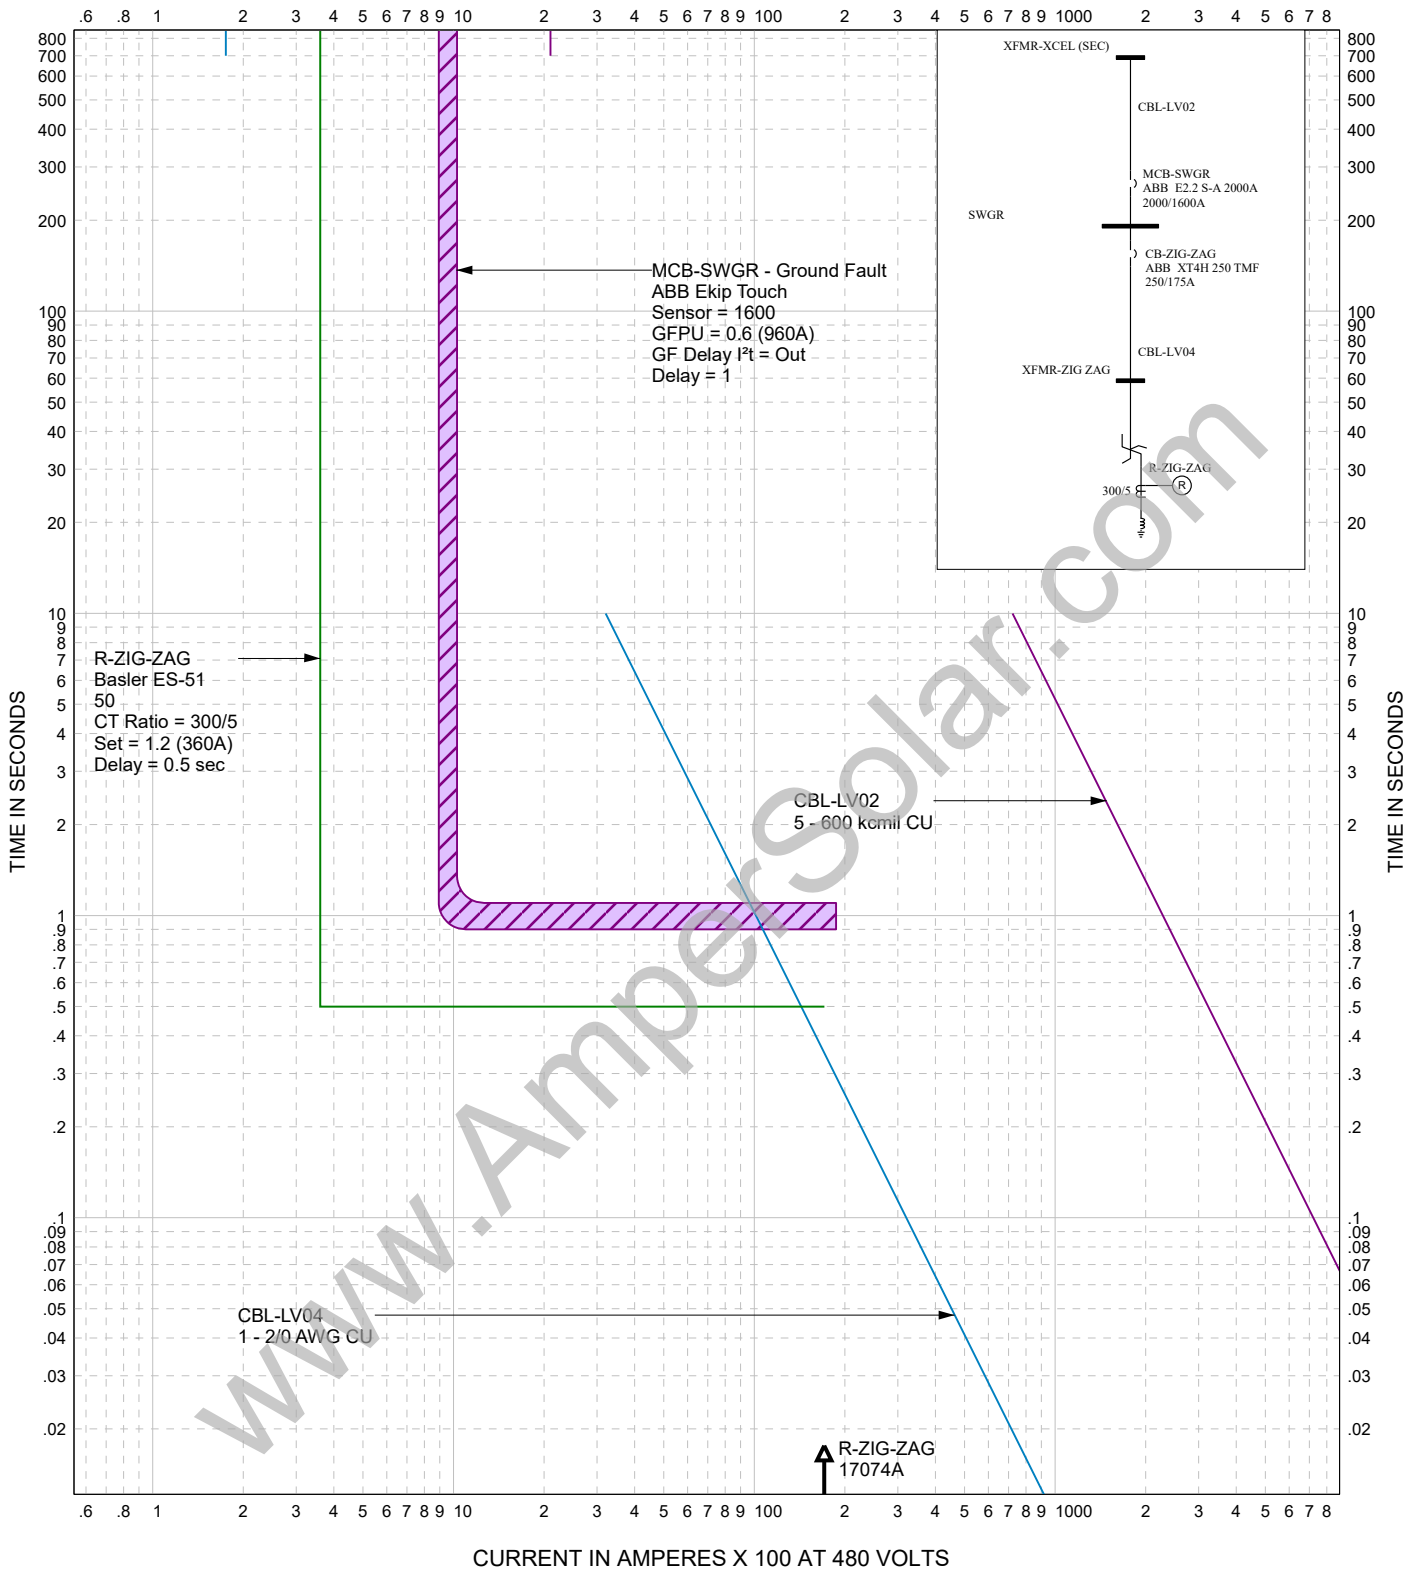

**EasyPower®**  
**TIME-CURRENT CURVES**

TCC-3

Recommended settings show best possible coordination

FAULT: SLG  
DATE: 02/13/2022  
BY: D. Evrim Ercan, P.E.  
REVISION: 0